



THE PORT AUTHORITY
OF NY & NJ




ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)

**Joseph R. Loring
& Associates, Inc.**
consulting engineers
One Pennsylvania Plaza
New York, New York 10004-0045
Tel: (212) 512-7400, Fax: (212) 512-7982


THE OFFICE OF
**DAVID
ELLIOT
LEBOWITZ
P.C.**
ARCHITECTS - PLANNERS
16700 20TH AVE. 18 HP FAN
NEW YORK, NY 10045
TEL: (212) 512-7400 FAX: (212) 512-7982

**LESLIE E. ROBERTSON
ASSOCIATES, R.L.L.P.**
CONSULTING STRUCTURAL ENGINEERS
16700 20TH AVE. 18 HP FAN
NEW YORK, NY 10045
TEL: (212) 512-7400 FAX: (212) 512-7982

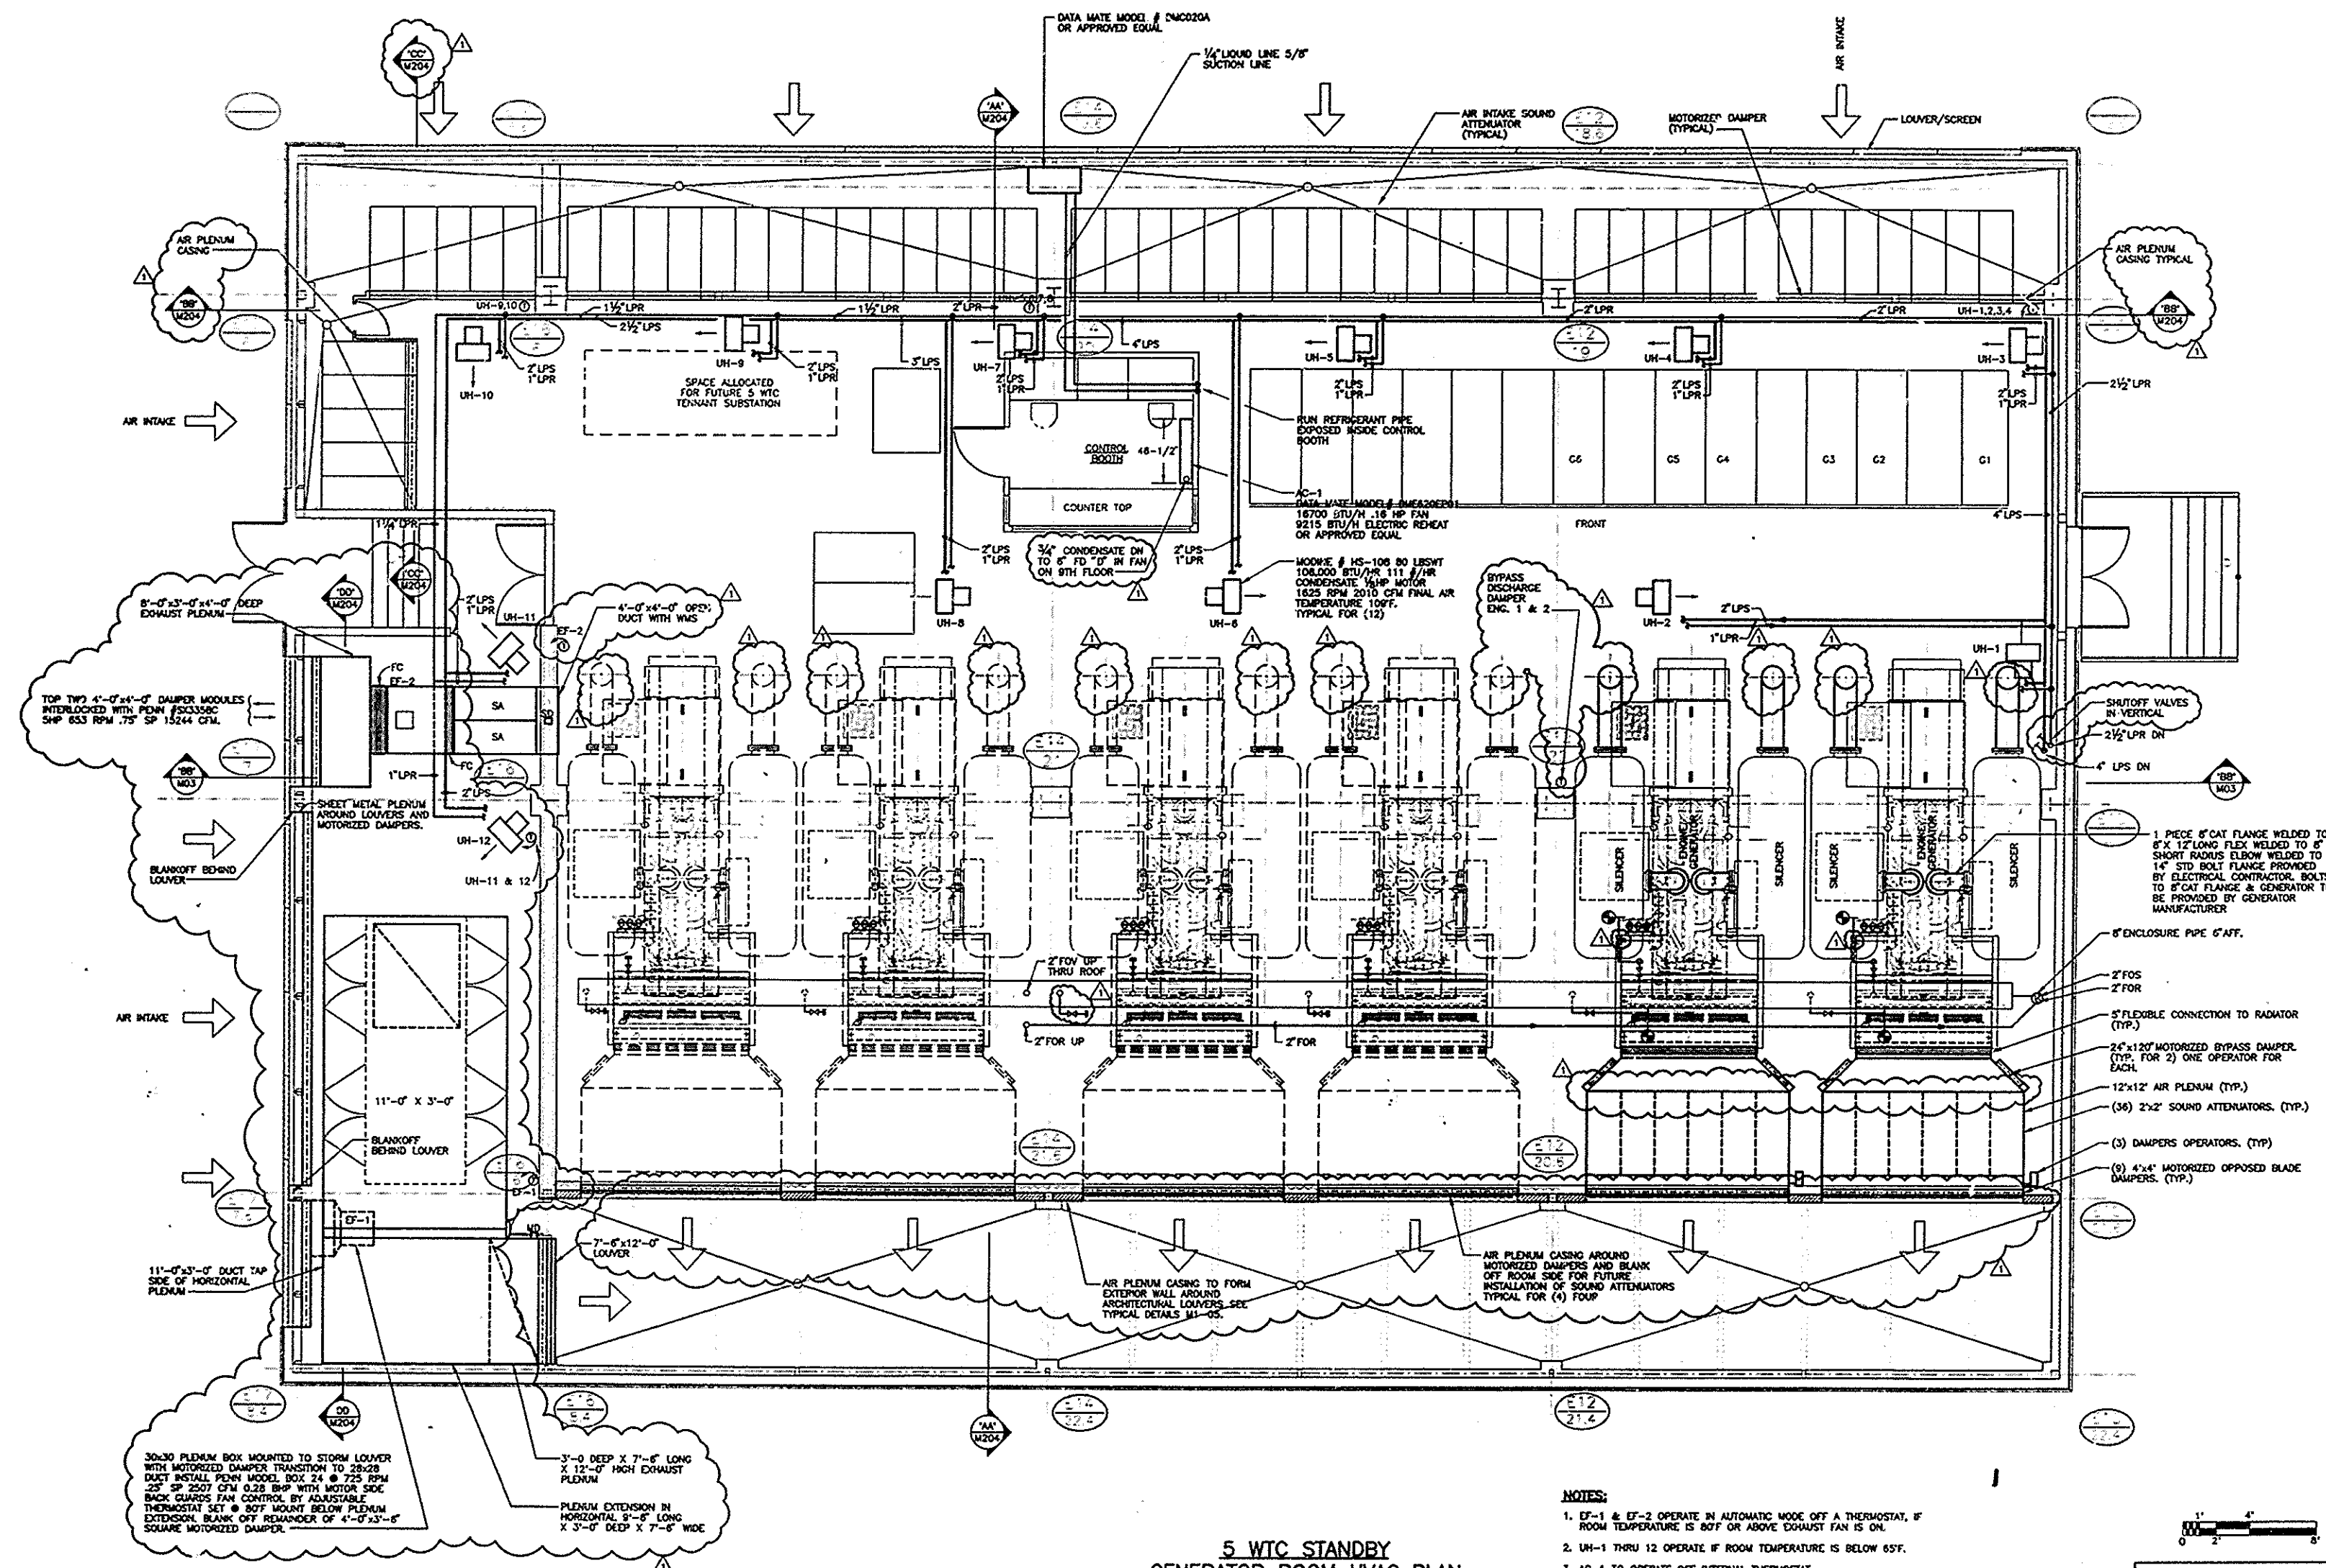

**5 WTC STANDBY
GENERATOR ROOM HVAC PLAN**

- NOTES:**
1. EF-1 & EF-2 OPERATE IN AUTOMATIC MODE OFF A THERMOSTAT, IF ROOM TEMPERATURE IS 80°F OR ABOVE EXHAUST FAN IS ON.
 2. UH-1 THRU 12 OPERATE IF ROOM TEMPERATURE IS BELOW 65°F.
 3. AC-1 TO OPERATE OFF INTERNAL THERMOSTAT.
 4. SILENCER FURNISHED BY ELECTRICAL, INSTALLED UNDER MECHANICAL WORK.

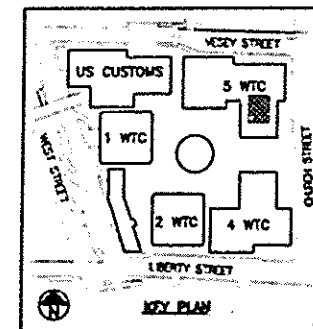

11/6/98 Sullivan A. Kellum
4/10/98 P.L.C. [Signature]
ENGINEER OF DESIGN

| No. | Date | Revision | Approved |
|---|----------|-----------------------------------|----------|
| 1 | 12/12/97 | GENERATOR BULKHEAD CLASSIFICATION | |
| 2 | 11/17/97 | ISSUED FOR BID | |
| Engineering Department Design Division | | | |

**5 WTC STANDBY
GENERATOR BULKHEAD
HVAC PLAN**

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

| | | |
|-----------------|----------------|----------|
| J.D. | M.A.R. | Check by |
| Designed by | Drawn by | |
| Date | Scale | |
| 11/17/97 | AS NOTED | |
| Contract Number | Drawing Number | |
| WTC-945.071 | M2-03 | |